


NOTE:
 IF SEPARATION IS LESS THAN 18", THEN ADDITIONAL REINFORCEMENT (REBAR OR MESH AREA) SHALL BE INCREASED AS DEEMED NECESSARY BY ENGINEER

NOTE:
 IF MANHOLE HAS ONLY ONE INFLUENT PIPE WHICH IS APPROXIMATELY 90 DEGREES TO EFFLUENT PIPE, THEN CONTRACTOR SHALL MAINTAIN A CHANNEL WITH A RADIUS HAVING THE SAME WIDTH AS THE INFLUENT PIPE.

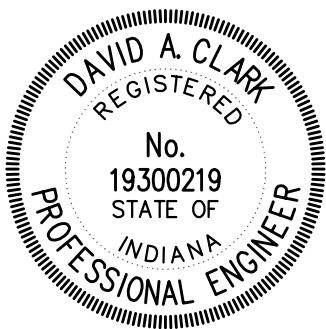

BENCHWALL DETAIL

David A. Clark



CLAY TOWNSHIP REGIONAL WASTE DISTRICT
 BENCHWALL DETAIL

