


| MANHOLE CASTING TABLE | |
|--|---------------------------------------|
| LOCATION | COVER |
| 18" INCHES OR MORE ABOVE 100 YEAR FLOOD ELEVATION OF ALL WATERWAYS | EAST JORDAN 1022Z1G6 OR NEENAH R-1772 |
| LESS THAN 18" ABOVE 100 YEAR FLOOD ELEVATION OF ALL WATERWAYS | EAST JORDAN 1022Z1PT |
| LID | |
| OWNERSHIP | LETTERING |
| PRIVATE | "SANITARY SEWER" |

- NOTE:
- GREASE TRAP SHALL CONFORM TO ASTM C 478 UTILIZING 4,000 PSI CONCRETE.
 - EXTERIOR INSTALLATION MUST BE CONCRETE OR CAST IRON. STEEL GREASE TRAPS SHALL ONLY BE INSTALLED INSIDE A BUILDING.
 - CONTRACTOR MAY SUPPLY GREASE TRAP AS MANUFACTURED BY ZURN SERIES Z-1170 OR JAY R. SMITH MANUFACTURING COMPANY SERIES 8000 IF INTERIOR INSTALLATION UTILIZED.



- NOTE:
- GREASE TRAPS MUST BE SIZED ACCORDING TO THE INDIANA STATE BOARD OF HEALTH BULLETIN S.E. 13, "ON-SITE WATER SUPPLY AND WASTEWATER DISPOSAL FOR PUBLIC AND COMMERCIAL ESTABLISHMENT", SECTION 501 - "GREASE TRAPS" AND PER LOCAL REQUIREMENTS OR CODES. THE SIZING METHOD FOR ALL STRUCTURES MUST BE APPROVED BY CTRWD.
 - SHOP DRAWINGS MUST BE SUBMITTED TO CTRWD FOR REVIEW AND APPROVAL.

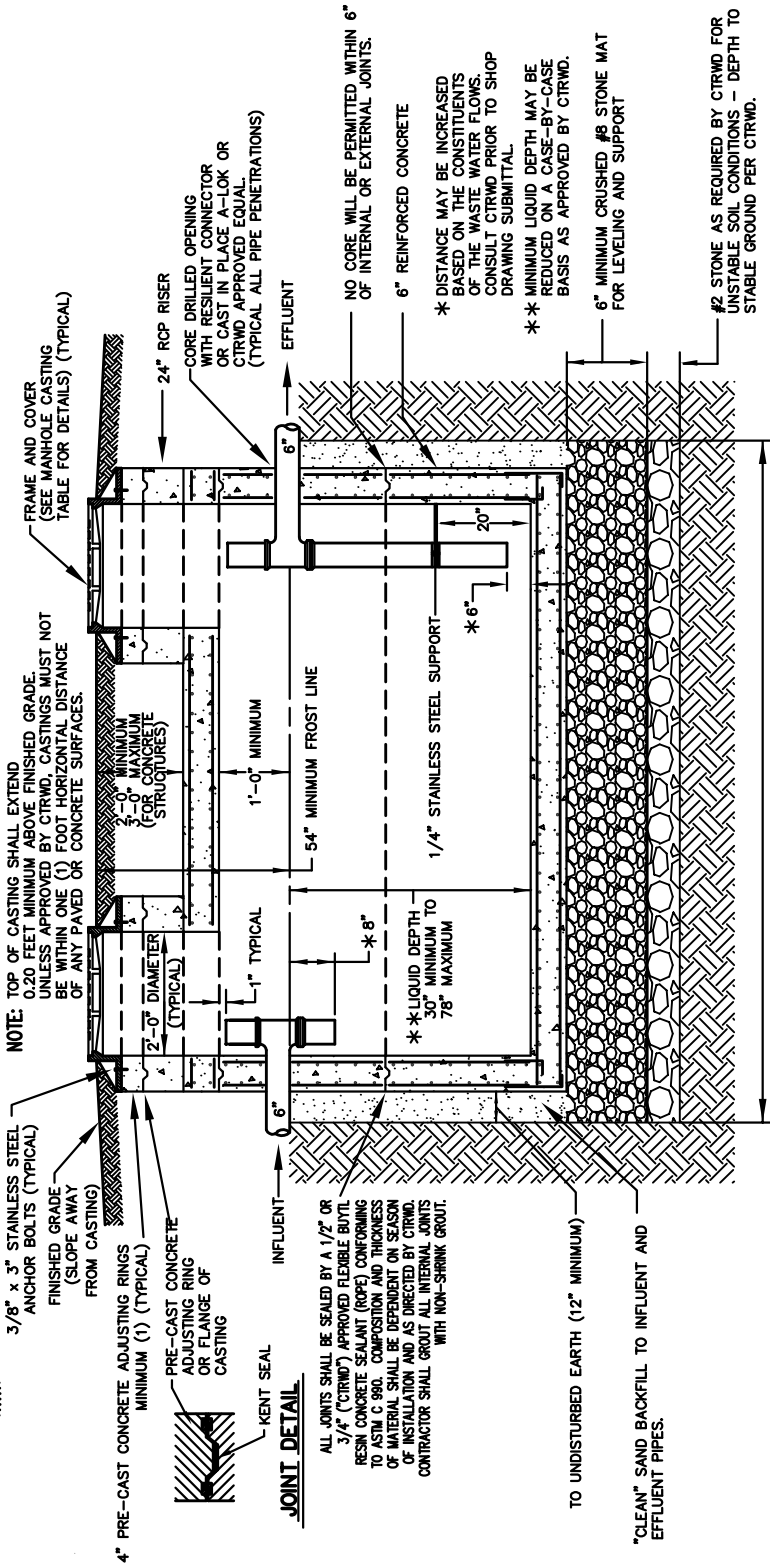

D.A. Clark



CLAY TOWNSHIP REGIONAL WASTE DISTRICT
GREASE TRAP DETAIL



EXTERIOR GREASE TRAP DETAIL