


IF "A" IS	IF "B" IS	THEN SANITARY SEWER PIPE SEGMENT SHALL BE
18" OR MORE	10' OR MORE	NO SPECIAL PIPE MATERIAL OR GRADE REQUIREMENTS
LESS THAN 18"	LESS THAN 10'	PVC (EITHER ASTM D 2241 (SDR 21) OR ANSI/AWWA C900 (DR 18) OR ANSI/AWWA C905 (DR 21) OR DUCTILE IRON (CLASS 51 MINIMUM))

NOTE: SEPARATION DISTANCES FROM WATER SUPPLIES AND PIPE CLASSIFICATIONS SHALL CONFORM TO INDIANA STATE BOARD OF HEALTH'S "ON-SITE WATER SUPPLY AND WASTEWATER DISPOSAL FOR PUBLIC AND COMMERCIAL ESTABLISHMENTS - BULLETIN S.E. 13"

## WELL/WATER SUPPLY & SEWER CROSSING DETAIL

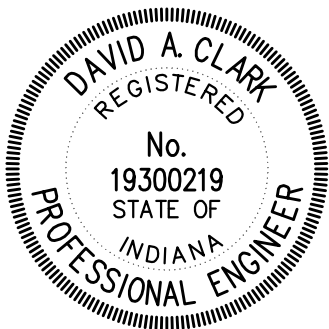

*David A. Clark*



CLAY TOWNSHIP REGIONAL WASTE DISTRICT  
WATER LINE CROSSING DETAIL

